

BE SERIOUS ABOUT SAFE STORAGE



Safety is a big concern when storing flammables such as petroleum, oil, lubricants and paints. After all, they're called flammables for a reason.

CTA 50-909 authorizes the purchase of storage cabinets for units that store flammables. FED LOG lists many sizes, shapes and colors, so order the cabinet that best suits your needs. Here are a few that might do the trick:

Cabinet Description	NSN 7125-
Yellow, 43 inches wide x 65 inches high x 18 inches deep	01-084-6955
Yellow with red "Flammable—Keep Fire Away", 43 inches wide x 65 inches high x 18 inches deep	01-035-3023*
Yellow with red "Flammable—Keep Fire Away" decal across both doors, 43 inches wide x 44 inches high x 18 inches deep, 30 gallon capacity	01-084-6954
Gray, 36 inches wide x 78 inches high x 24 inches deep	01-159-6943
Red with white "FLAMMABLE LIQUID" lettering on front, 4 shelves, 36 inches wide x 35 inches high x 24 inches deep	00-550-3356*

*Order on a DD Form 1348-6 and put "NSN not on AMDF" in the REMARKS block.



SAFETY'S NOT ENSURED JUST BECAUSE YOU HAVE A STORAGE CABINET, THOUGH.

FOLLOW THESE RULES FOR HANDLING AND STORING FLAMMABLES...


- Tighten all container lids.

- Remove any leaking containers immediately. Clean up all spills by following your unit's HAZMAT SOP.

- Ground containers before pouring from one to another. That prevents sparks from static electricity that could start a fire.



- Never exceed the maximum storage capacity of a cabinet. A cabinet's capacity is determined by safety, not by the number of containers it will hold. You'll find the capacity listed in the instruction sheet that comes with each cabinet.

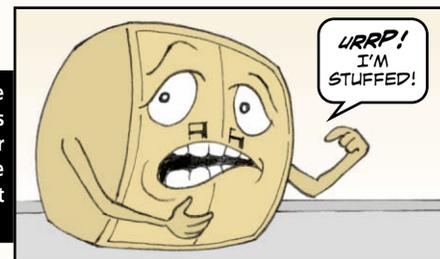


- Give paint its own storage cabinet. Never store it in the same cabinet as petroleum, oil or lubricants. Always check the Hazardous Materials Information System (HMIS) for compatibility before storing materials



- Locate indoor cabinets away from areas where spark-producing tools or equipment are used. Also keep them away from areas where heat, fumes and gases build.

- Check out the information in the National Fire Code 30, *Flammable and Combustible Liquids*, and AR 420-90, *Fire Protection*. If you do not have these books on hand, call your safety office. They should have copies and be able to tell you about local regulations.

- Put outdoor cabinets at least 50 feet from combustible structures. Keep the area around the cabinet free of weeds and debris. Place and enforce "No Smoking" signs.

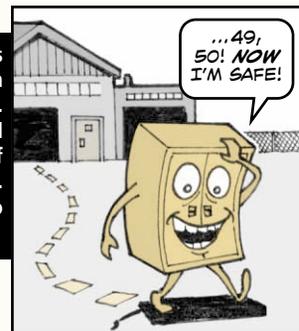

Order the signs with these NSNs:

NSN 7690-01-	Letter Height (inches)
032-3714	1
032-4602	11/2
032-4604	2
036-4777	3