


RESPIRATOR INFO

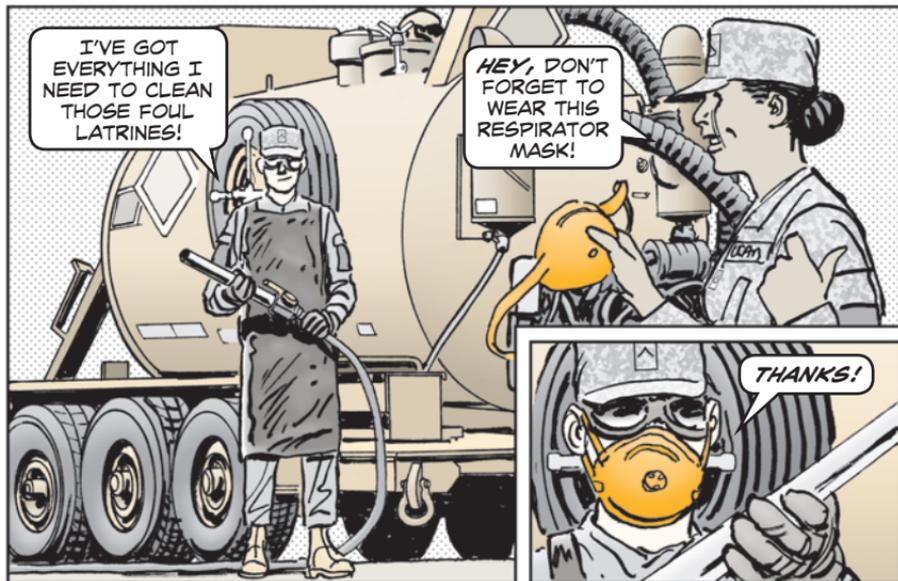

The waste water evacuation tank trailer is critical for servicing the containerized latrines in Force Provider base camps.

And critical for the operator are the safety items called out in Table 2 of the Basic Issue Items List in TM 10-4630-207-13&P. But the part number listed for the respirator doesn't cross to an NSN. So now what?

Well, the respirator you need is an N95 respirator with an exhalation valve. It's approved by the National Institute for Occupational Safety and Health (NIOSH). You can order the model listed in the TM from Lab Safety Supply using CAGE 6M644 and PN 48649. That'll get a box of 10 for about \$24. Your supply folks can use a government purchase card to order from their website: <http://www.labsafety.com>

According to Force Provider, it's OK to order a substitute respirator that already has been assigned NSN 4240-01-492-0177. It's not in the AMDF, so order it on a DD Form 1348-6, and put "NSN not in AMDF" in the REMARKS block.

THE ILLUSTRATION IN THE TM DOES **NOT** LOOK ANYTHING LIKE THE RESPIRATOR YOU'LL GET.

HERE'S WHAT IT SHOULD LOOK LIKE...

MAKE A NOTE OF THIS INFO UNTIL THE TM IS UPDATED.